


Project Name: _____ Contractor Name: _____

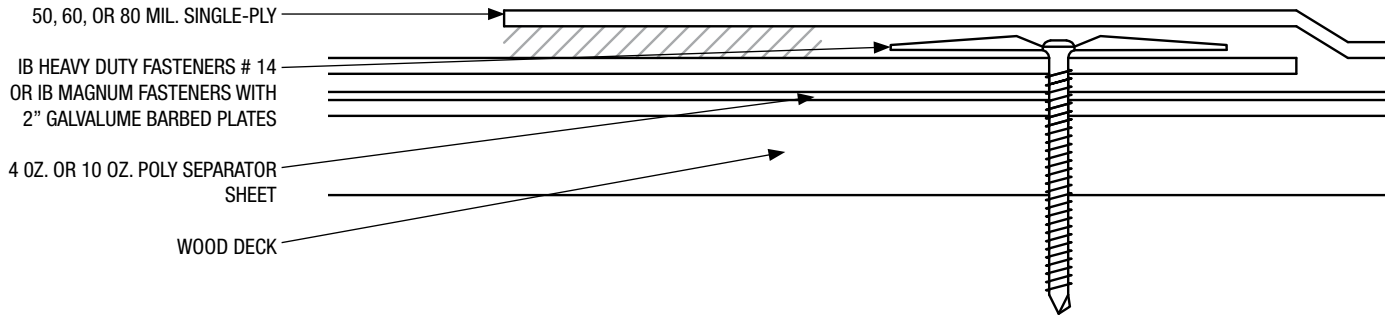

50 60 80 MA-SS-W (Wood) FastSpec™

| Wood Deck – New Construction or Re-Roof (Tear-Off) – Fire Rated, Mechanically Attached Membrane | | | | | | | |
|---|-----------|--|--------------------------------|---|---|---|---------------------------------------|
| Fire Rating | Deck Type | Separator Sheet | | 50, 60, or 80 mil. Single-Ply | | Max. Design Pressure** | |
| | | Type | Attachment | Fasteners | Attachment | | |
| <input type="checkbox"/> | None | Min. 5/8-inch plywood attached 6" o.c. with 8d common nails to supports spaced max. 24" o.c. | Fire Sheet 10 or Fire Sheet 50 | Max. 72-in. o.c. in min. 2-in. side laps spaced max. 46 in. apart with #12 Screw and 3" steel Insulation plate. | IB Heavy Duty Fasteners # 14 or IB Magnum Fasteners with 2" Galvalume Barbed Plates | Max. 12-in. o.c. in min. 5-in. side laps spaced max. 67 in. apart. Outside of seam sealed with min. 1.5 in heat weld. | -30.0 psf ⁽¹⁾ (FM-I-60) |
| <input type="checkbox"/> | None | Min. 1/2-inch plywood attached 6" o.c. with 8d common nails to supports spaced max. 24" o.c. | Fire Sheet 10 or Fire Sheet 50 | Max. 72-in. o.c. in min. 2-in. side laps spaced max. 46 in. apart with #12 Screw and 3" steel Insulation plate. | IB Heavy Duty Fasteners # 14 or IB Magnum Fasteners with 2" Galvalume Barbed Plates | Max. 6-in. o.c. in min. 5-in. side laps spaced max. 67 in. apart. Outside of seam sealed with min. 1.5 in heat weld. | -37.5 psf ⁽¹⁾ (FM-I-75) |
| <input type="checkbox"/> | None | Min. 5/8-inch plywood attached 6" o.c. with 8d common nails to supports spaced max. 24" o.c. | Fire Sheet 10 or Fire Sheet 50 | Max. 72-in. o.c. in min. 2-in. side laps spaced max. 46 in. apart with #12 Screw and 3" steel Insulation plate. | IB Heavy Duty Fasteners # 14 or IB Magnum Fasteners with 2" Galvalume Barbed Plates | Max. 6-in. o.c. in min. 5-in. side laps spaced max. 67 in. apart. Outside of seam sealed with min. 1.5 in heat weld. | -45.0 psf ⁽¹⁾ (FM-I-90) |

The above assemblies and the attachments were tested and approved for use in the field of the roof. It is the designer of record and/or the roofing contractor's responsibility to determine the pressures for all three zones of the roof (field, perimeter, and corners per ASCE-7 05 and the building code) and through extrapolation, the lap spacing for the perimeter and corners zones. Contact IB Should you need assistance. The roofing system must be installed in strict accordance with the current 'IB Roof Systems Specifications Manual and Details', the project specifications, the building code, and good roofing practices by an authorized IB Applicator. Deviations from these requirements, not approved in writing by IB Roof Systems and the Authority Having Jurisdiction are not covered by any or implied IB Roof Systems Warranty.

** Average pull-outs for the wood deck (per ANSI/SPRI FX 1-05): 350 lbs. (1) Does not constitute an FM system. For reference only.

| | | |
|---------------------------|---------------|------------------------|
| Solar Reflectance (White) | Initial: 0.87 | 3-Year Weathered: 0.74 |
| Thermal Emittance | Initial: 0.88 | 3-Year Weathered: 0.90 |

Available Warranties

| | | | |
|--------------------------|-----------------|-----------------------------|--|
| <input type="checkbox"/> | 50 Mil Membrane | <input type="checkbox"/> CG | 15-Year 'Material Only', Material and Labor, or No Dollar Limit (NDL). Additional warranties also available. |
| <input type="checkbox"/> | 60 Mil Membrane | <input type="checkbox"/> TR | 20-Year 'Material Only', Material and Labor, or No Dollar Limit (NDL). Additional warranties also available. |
| <input type="checkbox"/> | 80 Mil Membrane | <input type="checkbox"/> CG | 25-Year 'Material Only', Material and Labor, or No Dollar Limit (NDL). Additional warranties also available. |

IB Roof Systems are listed with the following agencies:

